
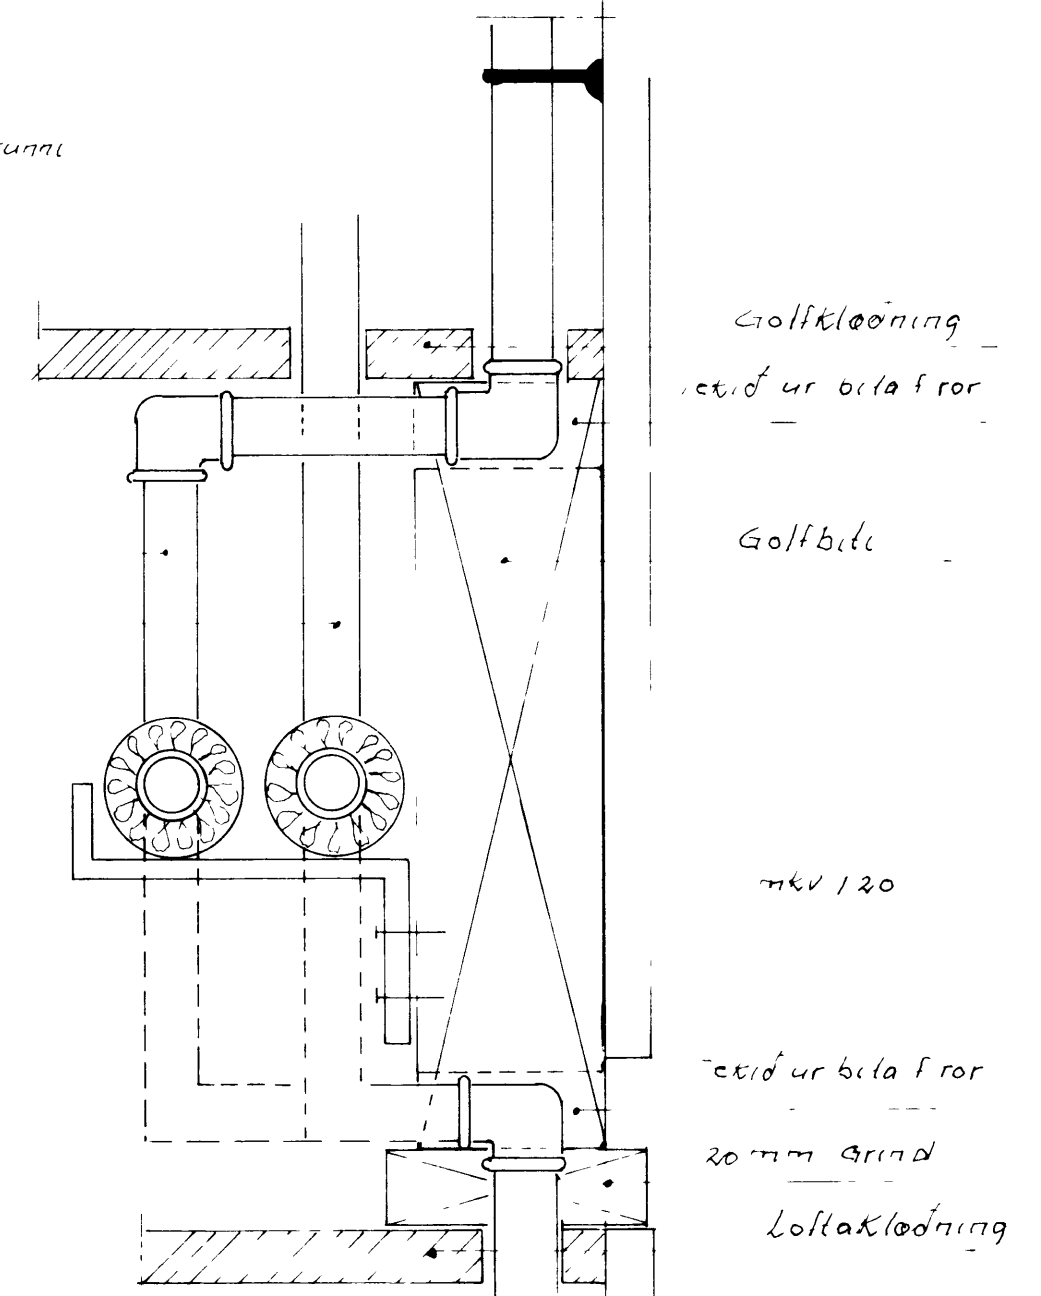
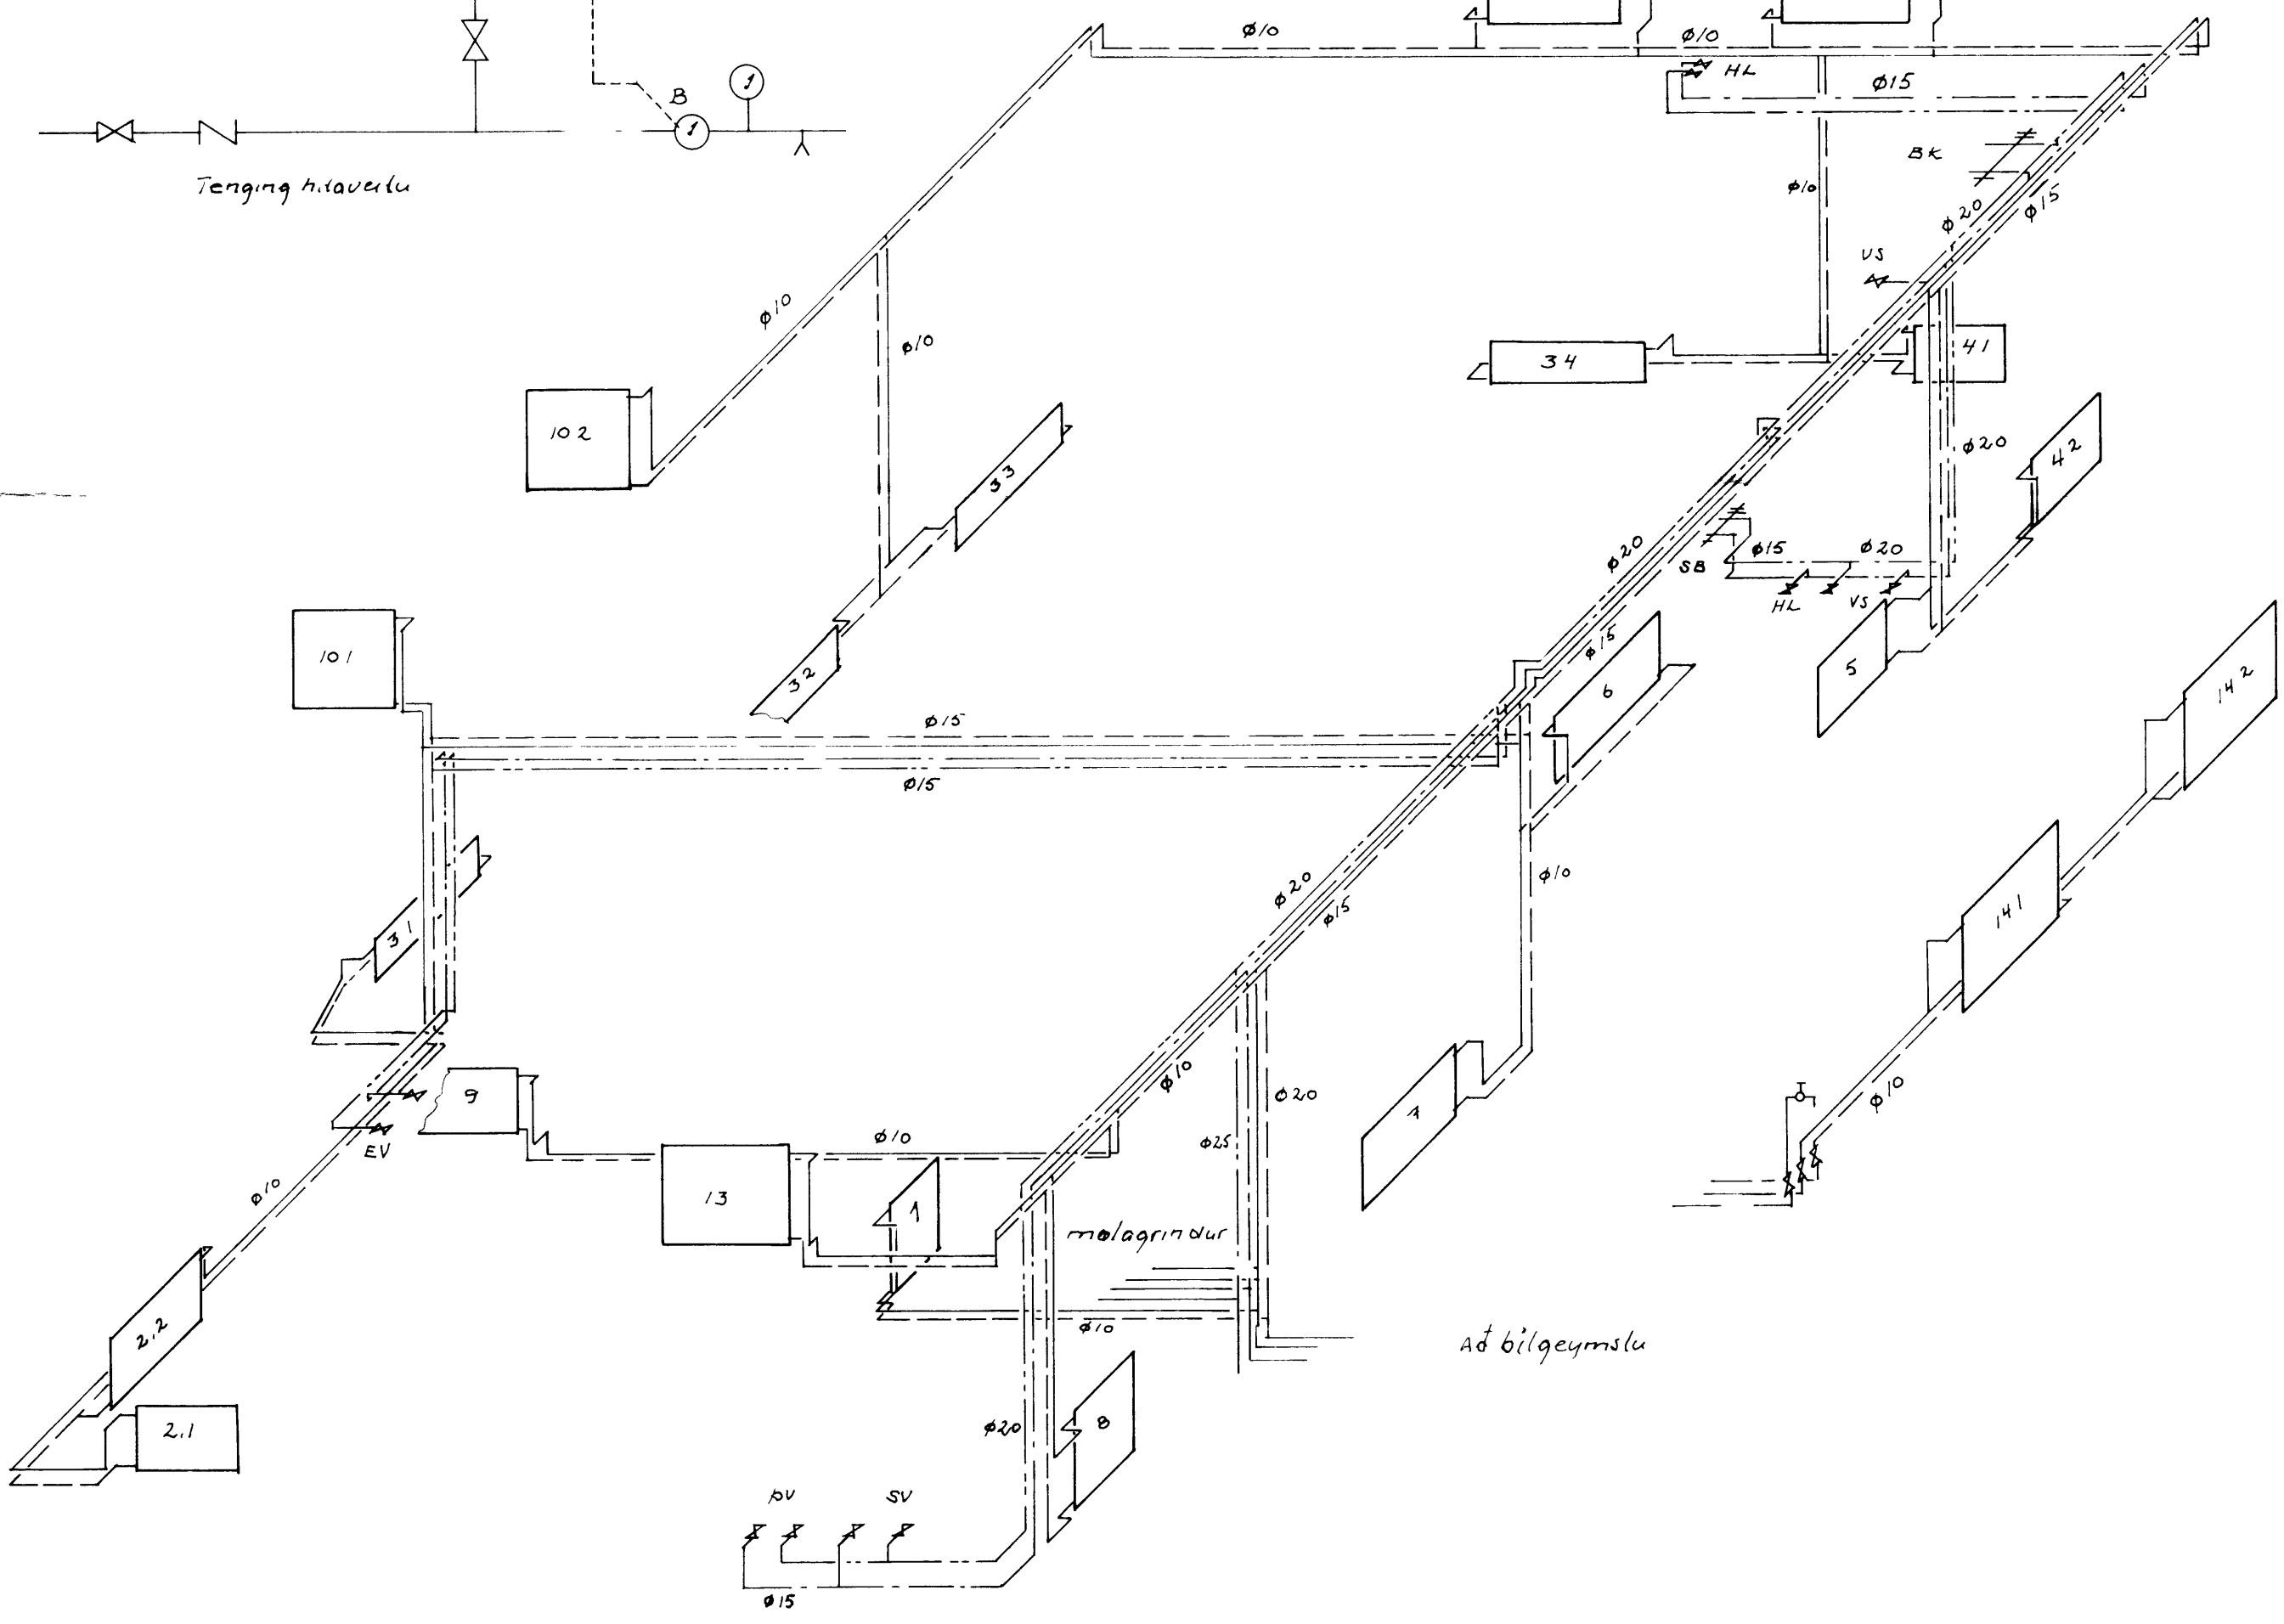


ólsýnleg rörskál þrifa og grunna með vidurkendum grunni

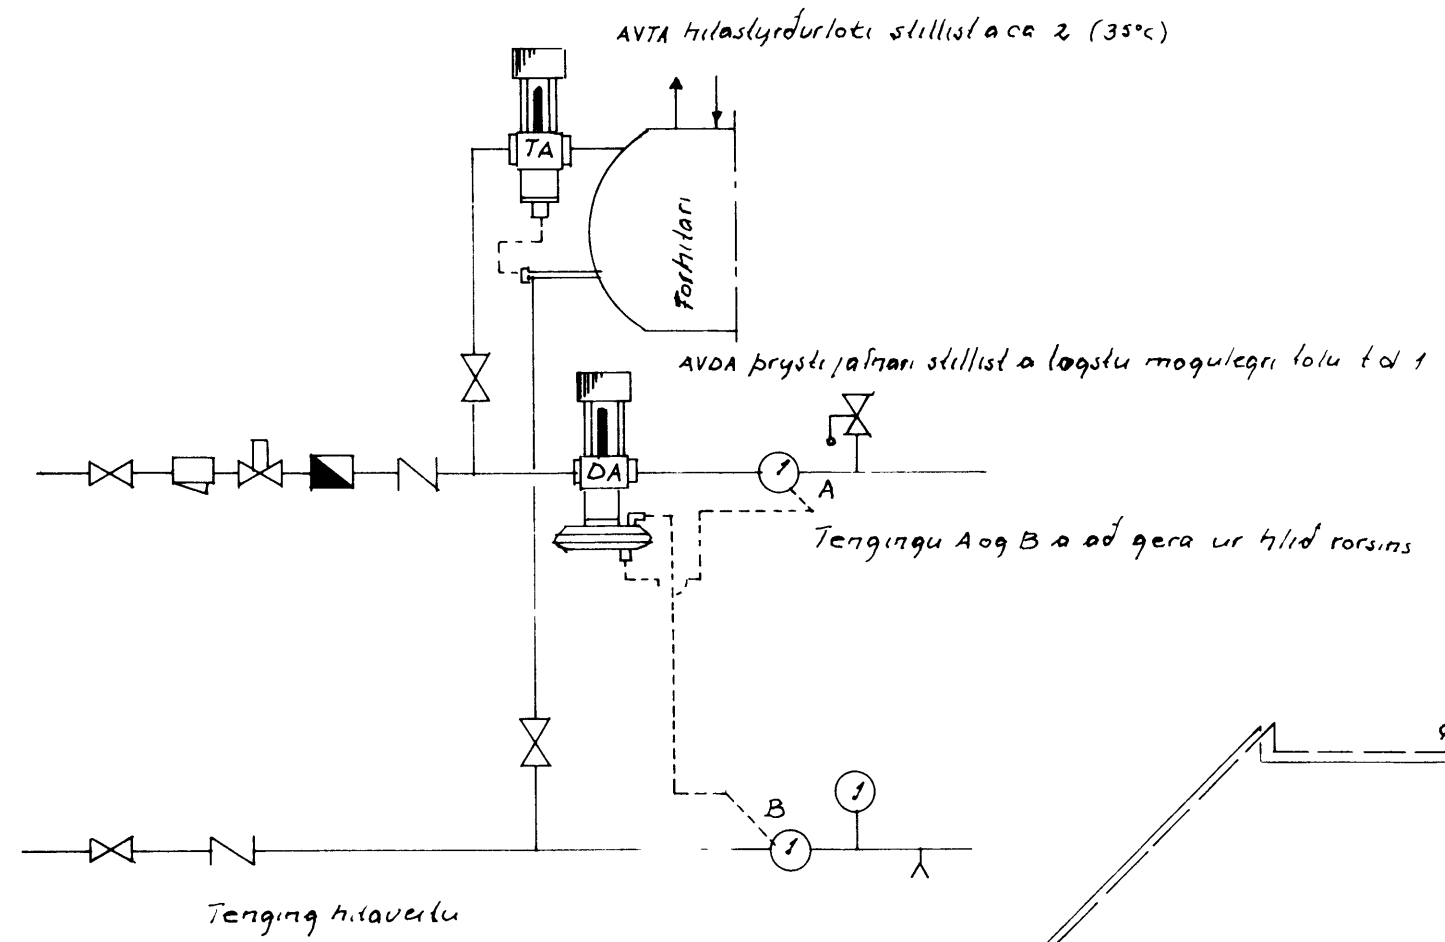

OFNASKRA

Nr	Herbergi	Varmabörf	Hamars-		Valdir ofnar at-40		Tenging	Ofnlokar					
			Watt	Hæð	Lengd	Afkoð		Þykkt	Hæð	Lengd	Dæmi um DANFOSS loka	Gerð	Afkoð
1	Anddyri	490	75	60			CD	FJVR		02	30		
2.1	Eldhus	660	60	100			CD	RAVL		02	35		1/arefara
2.2	"	660	60	100			CB	FJVR			35		
3.1	Stofa	820	30	120			AD	RAVL		02	30		
3.2	"	820	30	120			CB	FJVR			30		
3.3	"	820	30	20			AD	"			30		
3.4	"	820	30	120			CB	"			30		
4.1	Herbergi	420	60	80			AB	RAVL		02	30		
4.2	"	420	60	80			CD	FJVR			30		
5	Badherbergi	420	60	80			AB	"			30		Einfafn
6	Uppgangur	1400	60	160			CB	"			30		
7	Herbergi	630	60	100			AB	RAVL		02	30		
8	Þvott+Geymsl	1030	75	80			CD	FJVR			30		
9	Herbergi	620	60	100			AB	RAVL		02	30		
10.1	Skali	610	75	80			AB	"		02	30		
10.2	"	610	75	80			CD	FJVR			35		
11	Herbergi	750	60	100			CB	RAVL		02	30		
12	Badh	700	60	100			CB	"		02	30		
13	Hjón	1180	75	100			AB	"		05	30		
14.1	Bilgeymsl	1150	75	100			AD	FJVR			30		4th m/
14.2	"	1150	75	100			AB	"			25		Hilablasara
		16180											

VERK 24
 GODAHRUN 22 VESTMANNAEYJUM
 Rummynd Vatns og hilalagn

TEIKN NR 22 AF 8412

PÁLL ZÓPHONIÁSSON
 BYGGINGATÆKNIFRÆÐINGUR
 KIRKJUVEGI 23 - 98-2711
 900 VESTMANNAEYJUM

HANNAD R.G. TEIKNAD

KVARÐI 150