


**Ofnaskrá:**

Ofn nr.	Reiknað hitataki Keal	Hámarks Hæð mm	Lengd mm	Görð Panel /Hæð x Lengd	Hitaþjóf	Stöðs-skíta	A.Þ.
1.01	2200	1000	3500	EK/ 750 x 3200	2080	A-D	
1.02	770	1000	1600	E/ 750 x 1400	720	C-D	
1.03	610	750	1200	E/ 750 x 1200	616	B-C	
1.04	270	1000	1000	E/ 600 x 600	290	B-C	
1.05	390	1000	1000	E/ 750 x 800	412	A-B	
2.01	1000	500	1000	PK/ 500 x 1000	1170	A-B	
2.02	1000	500	1000	PK/ 500 x 1000	1170	B-C	
2.03	560	600	700	TK/ 600 x 600	658	A-B	
2.04	1650	600	1800	TK/ 600 x 1800	1645	A-D	
2.05	1600	750	2400	EK/ 750 x 2400	1556	A-D	
2.06	410	750	900	E/ 750 x 800	412	A-B	
2.07	800	750	1200	EK/ 750 x 1200	778	C-D	
2.08	700	750	1400	EK/ 750 x 1400	745	B-C	
2.09	1070	500	1000	PK/ 500 x 1000	1170	C-D	
3.01	600	750	1100	E/ 750 x 1000	598	A-D	
3.02	560	750	1100	E/ 750 x 1000	598	A-D	
3.03	500	750	1100	E/ 750 x 1000	598	A-D	
3.04	200	850	2000	E/ 750 x 1800	925	A-D	
3.05	800	750	1100	T/ 750 x 1000	828	C-D	

$\Delta t$  er 40°

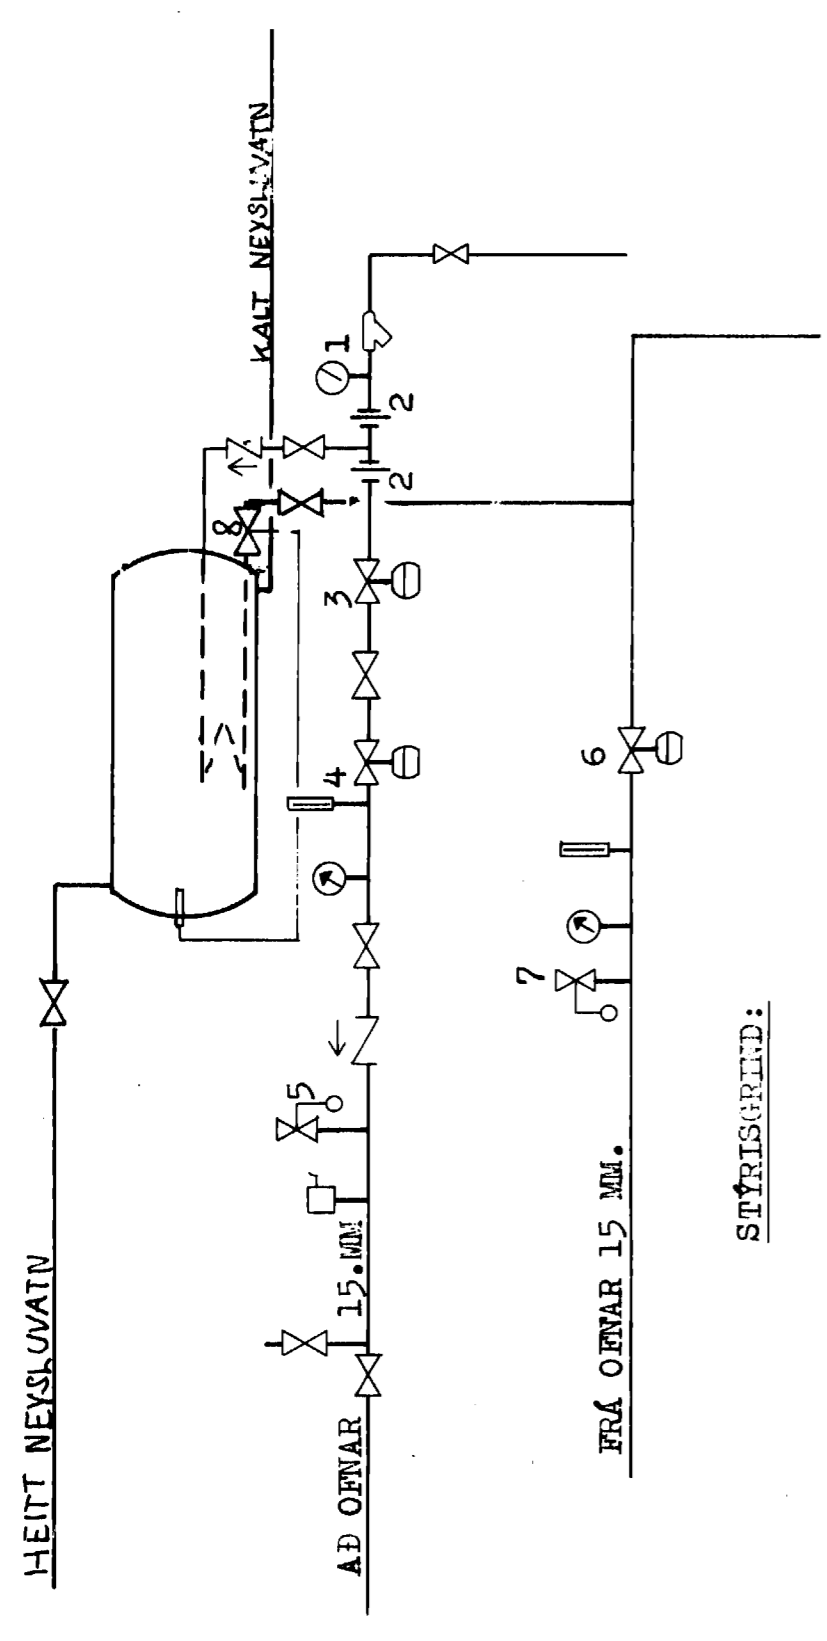

- SKÝRINGAR:**
- 1. SÍA (S.D.DANFOSS FV).
  - 2. HEMILL (BLENDI).
  - 3. HEMILL (SJÁLSTYRÐUR).
  - 4. ÞRÉSTJAFVARI DANFOSS AVD 15 DA
  - 5. ÖRYGGISLOKI STIILLI Á 5 KG/CM<sup>2</sup>.
  - 6. SLAUFLOKI DANFOSS AVD 15.
  - 7. ÖRYGGISLOKI STIILLI Á 5 KG/CM<sup>2</sup>.
  - 8. DANFOSSLOKI ATVB 15

- HEITI NEYSJUVAATN
- HEITT NEYSJUVAATN
- ÞITI FRAMRÁSARPIPA
- ÞITI EKKRÁSARPIPA
- SKÓLÞRÆSI
- VAÐNRÆSI
- FJARSTYRT IOKI RAVL
- DANFOSS ÖFNIOKI RAVL 10
- DANFOSS ÖFNIOKI FVÞR 10
- SÍA
- IOFTGILÐRA
- HEMILL
- RENNILOKI
- EINSTREYMISLOKI
- SJÁLSTYRÐUR IOKI
- ÖRYGGISLOKI
- HITAKLIR
- ÞRÉSTJAFVARI
- RENNILOKI M. SPINDIL.

**STREMBUGATA 8 Vestmannaeyjum**

KNÚTUR AKSEIÐSSON  
HEILINÆTIS & HITALÖGN  
TÆKNIFRÆÐINGUR  
OFNASKRA STYRISGRIND  
FURULUNDUR 5,  
GARÐABÆ. S. 40536.

maí, '82. *André*  
TEKNI: E.P.  
NR:105.02.07.